



# INSPECTION GUIDEBOOK

For firestopping installations



# TABLE OF CONTENTS

<b>1. Fire protection basics</b>	<b>4</b>
1.1 Active and passive fire protection	4
1.2 Compartmentation	5
1.3 Firestop systems	6
<b>2. Difference between firestopping and fireblocking</b>	<b>7</b>
<b>3. Firestop codes and standards</b>	<b>8</b>
3.1 Building codes requirements	8
3.2 Applicable standards	8
<b>4. Third party testing agencies</b>	<b>9</b>
4.1 Identification guide (UL)	9
4.2 Nomenclature for penetrations	10
4.3 Nomenclature for joints	11
<b>5. Listed firestop systems</b>	<b>12</b>
<b>6. Engineering judgments (EJ)</b>	<b>13</b>
6.1 UL Technical Evaluation Developer Program	14
<b>7. Inspection process</b>	<b>15</b>
<b>8. Inspection guidelines for through penetrations firestop systems</b>	<b>16</b>
8.1 Steps for inspection	16
8.2 Example comparison	17
8.2.1 Correct installation	17
8.2.2 Incorrect installation	18
<b>9. Inspection guidelines for membrane penetrations firestop systems</b>	<b>19</b>
9.1 Steps for inspection	19
9.2 Correct examples	20
<b>10. Inspection guidelines for fire resistive joints</b>	<b>21</b>
10.1 Steps for inspection	21
10.2 Example comparison	22
10.2.1 Correct installation	22
10.2.2 Incorrect installation	23
<b>11. Inspection guidelines for perimeter fire barrier systems</b>	<b>25</b>
11.1 Steps for inspection	25
11.2 Example comparison	26
11.2.1 Correct installation	26
11.2.2 Incorrect installation	26

- 12. Highly recommended global best practices ..... 27
- 13. Performance of construction materials under fire ..... 28
  - 13.1 Mineral wool vs. insulation. .... 28
  - 13.2 Combustible and non-combustible pipes ..... 28
  - 13.3 Dependency on tested system. .... 28

**Intended for use**

This guidebook is intended to provide construction professionals and code enforcement officials with general guidance on the inspection of various firestopping applications within fire rated construction. This guidebook is not intended to be all encompassing or to be used as a design guide. It is solely for information purposes only.



# 1. FIRE PROTECTION BASICS

Fire protection refers to the measures taken to prevent fires from igniting, reducing the impact of an uncontrolled fire, or extinguishing fires. There are three primary strategies for fire protection in construction:



Fig. 1

- **Detection:** Fire alarm systems are considered active fire protection, as their smoke and heat-detecting sensors respond to the presence of fire. These systems are designed to detect and alert building occupants and emergency response teams to the presence of smoke, fire, carbon monoxide or other fire-related emergencies within the building.
- **Suppression:** Fire suppression systems are also a part of active fire protection and are used to extinguish, control or, in some cases, entirely prevent fires from spreading or occurring. Sprinkler systems are the most commonly used form of suppression.
- **Containment:** Fire containment is achieved by creating robust fire compartments within a building that prevent the spread of fire and smoke and allow occupants to evacuate a building.

Fire detection and suppression systems are categorized as active fire protection systems that utilize smoke detectors, sprinklers etc. to detect and stop the fire, whereas fire containment is a passive fire protection system designed to help prevent the spread of fire or smoke,

## 1.1 Active and passive fire protection

- **Active fire protection** refers to anything that needs a follow-up action to help stop or combat a fire. This comes into action immediately after the fire starts. Examples include activation of fire sprinklers or the use of hoses, water spray or deluge until the fire is completely extinguished.
- **Passive fire protection** refers to components or systems of a building or a structure that slow or impede the spread of fire or smoke without system activation, and usually without movement. Examples include fire resistance rated walls, floors, glass, intumescent paint and coatings.

## 1.2 Compartmentation

Compartmentation is the key principle to ensure that there are physical (or “passive”) barriers in place to restrict the movement of fire and smoke within a building. The main objective of compartmentation is to contain a fire within a specific section of a building, limiting the passage of flames and smoke. This then allows more time for occupants to safely evacuate a building and to protect valuable assets. Architects, planners, engineers, and building owners all play a role in ensuring effective and well-designed compartmentation. As a criterion, the fire rating of the firestop system in the fire rated assembly should be greater than or equal to the fire rating of the compartment itself.

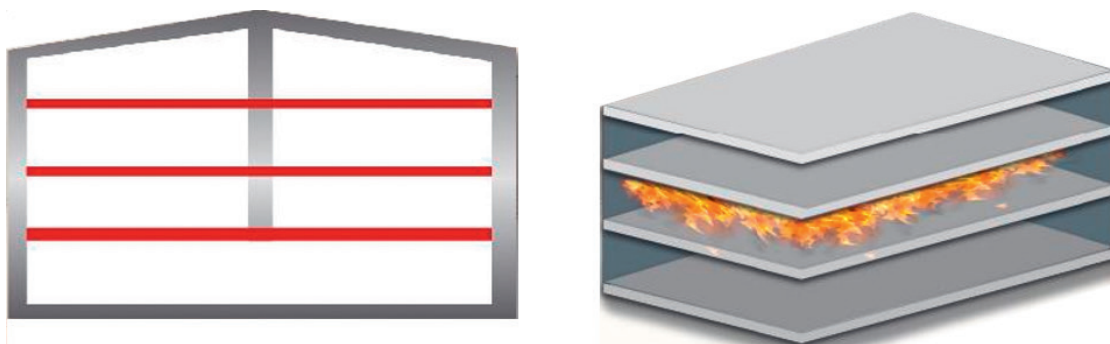


Fig. 2: Horizontal compartments along the height of the building

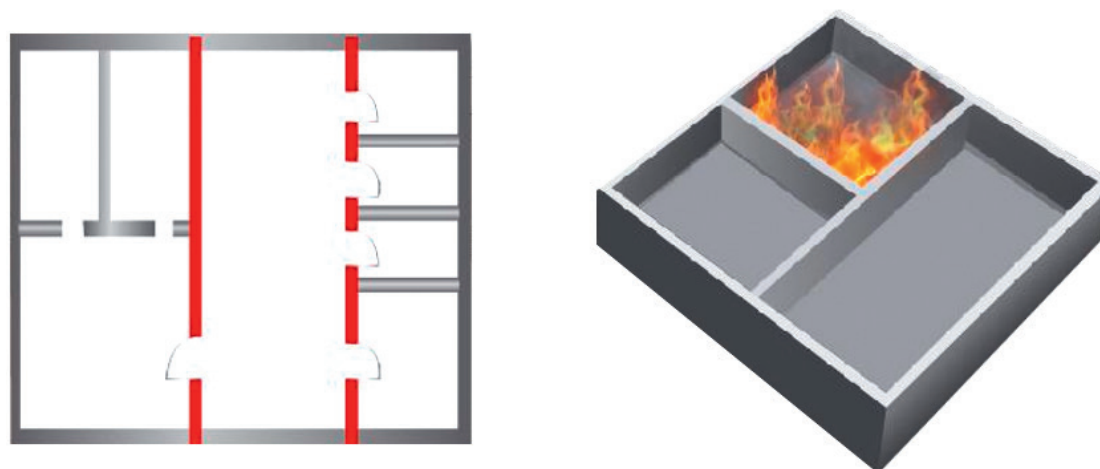


Fig. 3: Vertical compartments dividing the floor plan into sections

Compartments help stop the spread of fire, limit the fuel supply and cut off the supply of oxygen. Therefore, they attack the three main components of a fire: heat, fuel, and oxygen. Compartments also protect escape routes, such as corridors and stairs, allowing more time for occupants to safely evacuate the building and for firefighters to extinguish the flames.

The degree of sub-division that should be provided by fire compartments depends on various factors. Therefore, additional guidance is given by different local regulations based on:

1. The type and occupancy of the building (e.g., hospital, mall, hotel, residential or industrial building etc.)
2. The fire load in the building (e.g., storage room with hazardous liquids)
3. The height of the building (e.g., single story house or high-rise building)
4. The availability of a sprinkler system

### 1.3 Firestop systems

Firestop systems are designed and installed to impede the passage of fire and toxic smoke, with some systems designed to also restrict water and sound, through construction openings in fire-rated assemblies (walls and floors).

Throughout a building, the fire-rated assemblies are breached to allow the passage of piping, conduits, cable trays and other building system components to extend from room to room. In addition, openings or gaps between the wall and floor surfaces of the fire rated assemblies might exist to allow for movement or deflection of the assembly. To restore the integrity of the fire rated assembly, all the openings or penetrations need to be sealed to maintain the original fire rating of the assembly.

- **Through penetration firestop systems** are used to restore the integrity of a fire-rated floor or wall assembly when a penetrating item passes through the assembly.
- **Fire resistive joint systems** are used to protect the joints or spaces installed within or between fire-rated assemblies.
- **Membrane penetration firestop systems** are used to restore the integrity of a fire-rated wall assembly when only one side of the wall is penetrated.
- **Perimeter fire containment systems**, which are specific constructions consisting of a floor with an hourly fire rating, an exterior curtain wall with no hourly fire rating, and material installed to fill gaps between the floor and the curtain wall to prevent the vertical spread of fire in a building.

## 2. DIFFERENCE BETWEEN FIRESTOPPING AND FIREBLOCKING

Often times firestopping products and fireblocking materials are mistakenly interchanged. However, the purpose and application for using a firestopping product versus a fireblocking material differ as described below.

- **Firestopping** is a process whereby certain materials, some of them specially manufactured, are used to resist (or stop) the spread of fire and its byproducts through openings made to accommodate penetrations in fire-rated walls, floors and floor/ceiling assemblies.
- **Fireblocking** is defined as generic materials such as lumber, structural wood panels, gypsum board, cement fiberboard or particleboard, batts or blankets of glass, or mineral wool, installed within concealed spaces to resist or block the migration of fire and hot gases for an undetermined period. Fire blocking is used to subdivide or block off the stud cavity inside a wall, in a soffit over cabinets, between stair stringers at the top and bottom of a run, in an exterior cornice or in the space between the combustible finish materials and the wall itself.

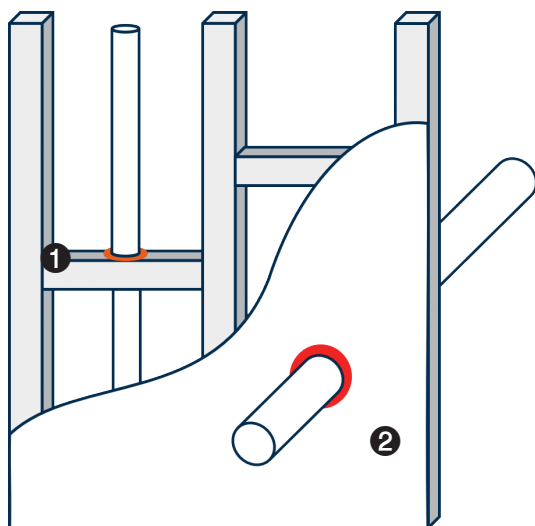


Fig. 4: Difference between firestopping and fire blocking

- ① Fireblocking – the use of approved building material to resist or block the migration of fire and hot gases within concealed spaces.
- ② Firestopping – a form of fire protection that is used to seal around penetrations (openings) through a fire-rated wall or floor assembly.

## 3. FIRESTOP CODES AND STANDARDS

### 3.1 Building codes requirements

Firestopping is well defined in the model building codes and safety codes. The various firestop codes and standards help to define where firestopping is required within a building, the appropriate testing standards, and other requirements to ensure life safety. The following list references some of the relevant code sections related to firestopping.

- International Building Code (IBC) (2018 Edition)
  - Section 714.4.1.2 Through Penetration Firestop (walls)
  - Section 714.4.2 Membrane Penetrations
  - Section 714.5.1.2 Through Penetration Firestop (floors)
  - Section 714.5.4 Smoke Barriers
  - Section 715.1 Joints
  - Section 715.4 Curtain Wall
  - Section 715.6 Joints (Smoke Barriers)
- International Fire Code (IFC) (2018 Edition)
  - Section 701.2 Fire Resistance Rated Construction
  - Section 701.3 Smoke Barriers
  - Section 701.4 Smoke Partitions
- NFPA 101: Life Safety Code (2018 Edition)
  - Section 8.3.4.1.1 Penetrations
  - Section 8.3.4.7.1 Membrane Penetrations
  - Section 8.3.5 Joints
    - Section 8.3.5.4.1 Curtain Walls and Perimeter Joints
- UAE FIRE and Life Safety Code of Practice
  - 7.1.12. Through- penetration Fire stop System
  - 7.1.13. Fire resistant Joint System
  - 7.1.14. Membrane Fire stop System
  - 7.1.17. Perimeter fire barrier system/Exterior curtainwall/floor intersection
  - 3.6.1. Inspection of through penetration firestop systems
  - 3.6.2. Inspection of fire resistive joints and perimeter barriers
- SAUDI BUILDING CODE-GENERAL SBC 201-CR
  - 714.3.1.2 Through- penetration Fire stop System.
  - 715.3 Fire resistant Joint System
  - 715.4 Exterior curtain wall/floor intersection
  - 1705.17.1 Penetration Firestop Inspection
  - 1705.17.1 Fire-resistant joint systems Inspection



## 3.2 Applicable standards

Test standards relevant to firestop systems:



1. ASTM E 1399 “Cyclic Movement and Measuring the Minimum and Maximum Joint Widths of Architectural Joint Systems”
2. ASTM E 1966 (ANSI/UL 2079) “Standards Test Method for Fire-Resistive Joint Systems”
3. ASTM E 2174 “Standard Practice for On-Site Inspection of Installed Firestops”
4. ASTM E 2307 “Standard Test Method for Determining the Fire Resistance of Perimeter Fire Barrier Systems Using the Intermediate Scale, Multi-Story Test Apparatus”
5. ASTM E 2336 “Standard Test Methods for Fire Resistive Grease Duct Enclosure Systems”
6. ASTM E 2393 “Standard Practice for On-Site Inspection of Installed Fire Resistive Joint System and Perimeter Fire Barriers”
7. ASTM E 2750 “Standard Guide for Extension of Data from Firestop Penetration System Tests Conducted in Accordance with ASTM E814”
8. ASTM E 814 (ANSI/UL 1479) “Standard Test Method for Fire Tests of Through-Penetration Firestops”
9. ICC ES AC179 “Acceptance Criteria for Metallic HVAC Duct Enclosure Assemblies”
10. ISO 6944 “Fire Resistance Tests – Ventilation Ducts”

## 4. THIRD PARTY TESTING AGENCIES

There are several independent testing laboratories, also referred to as third party testing agencies, which perform fire testing of firestop manufacturer products in accordance with a specific fire test standard. After successful completion of the fire tests, the agencies generate details of the tested firestop systems. These details are usually included as design listings in the fire resistance directories published by the testing laboratory. These directories are an important source of information during the plan review process and inspection process.

The following are some of the recognized independent laboratories conducting tests of firestop systems:



1. Underwriters Laboratories Inc. (UL), Northbrook, IL  
(847) 272-8800, [www.ul.com](http://www.ul.com)
2. Southwest Research Institute San Antonio, TX  
(210) 522-2311, [www.fire.swri.org](http://www.fire.swri.org)
3. Factory Mutual Norwood, MA  
(781) 762-4300, [www.fmglobal.com](http://www.fmglobal.com)
4. Intertek Testing Services, San Antonio, TX  
(210) 625-8100, [www.intertek.com](http://www.intertek.com)

### 4.1 Identification guide (UL)

To identify the most relevant or closest UL firestop system that meets a contractor's unique site requirement, one should be aware of the different nomenclatures UL follows to categorize its various documents.

For each category/type of firestop system, UL has a separate UL Category Control Number

- XHEZ (Through-penetration firestop systems)
- XHBN (Joint systems)
- XHHW (Fill, void, or cavity materials)
- XHDG (Perimeter fire containment systems)
- CLIV (Wall opening protective materials)

To further narrow down the search within the category control number, UL uses the following nomenclature rules.


## 4.2 Nomenclature for penetrations

Firestop systems are identified in this category by an alphanumeric identification system.

The first alpha component identifies the type of assembly being penetrated i.e. walls, floors or both.

The second alpha component identifies the material of assembly being penetrated and the numeric

component identifies the type of penetrating item in a sequential format.

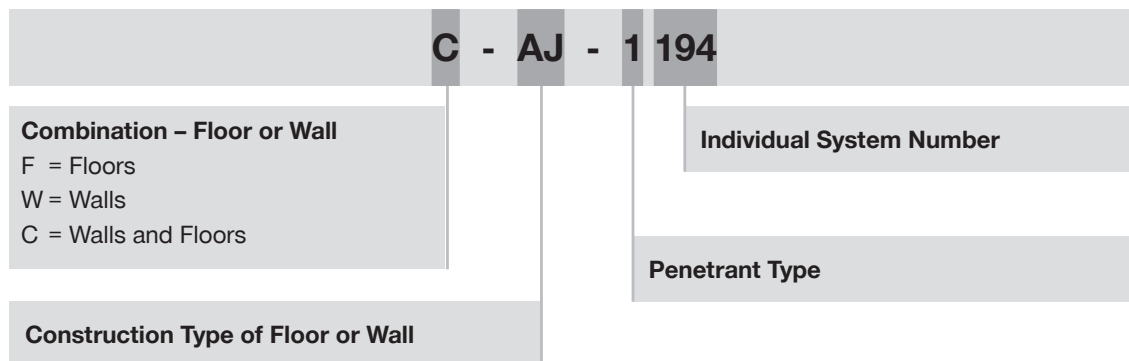

### Second letter(s) provide more info on wall/floor:


- **A:** Concrete floors ≤ 5 inches thick
- **B:** Concrete floors > 5 inches
- **C:** Framed floors – floor/ceiling assemblies
- **D:** Steel deck construction
- **J:** Concrete or masonry walls ≤ 8 inches thick
- **K:** Concrete or masonry walls > 8 inches thick
- **L:** Framed walls – gypsum wallboard assemblies

### 1<sup>st</sup> digit describes the penetrating item(s):

- **0:** Blank openings
- **1:** Metal Pipe, conduit, or tubing
- **2:** Non-metallic pipe, conduit or tubing
- **3:** Cables
- **4:** Cable trays
- **5:** Insulated pipes
- **6:** Miscellaneous electrical (busways)
- **7:** Miscellaneous mechanical (ductwork)
- **8:** Groupings of penetrations, including any combination of items listed above

### 4.3 Nomenclature for joints

The joint systems are identified by an alphanumeric identification system. The first two alpha characters identify the type of joint system. The third alpha character is either S or D. The S (static) signifies joint systems that do not have movement capabilities. This D (dynamic) signifies joint systems that do have movement capabilities. The numeric component uses sequential numbers to identify the nominal width of the joint systems.

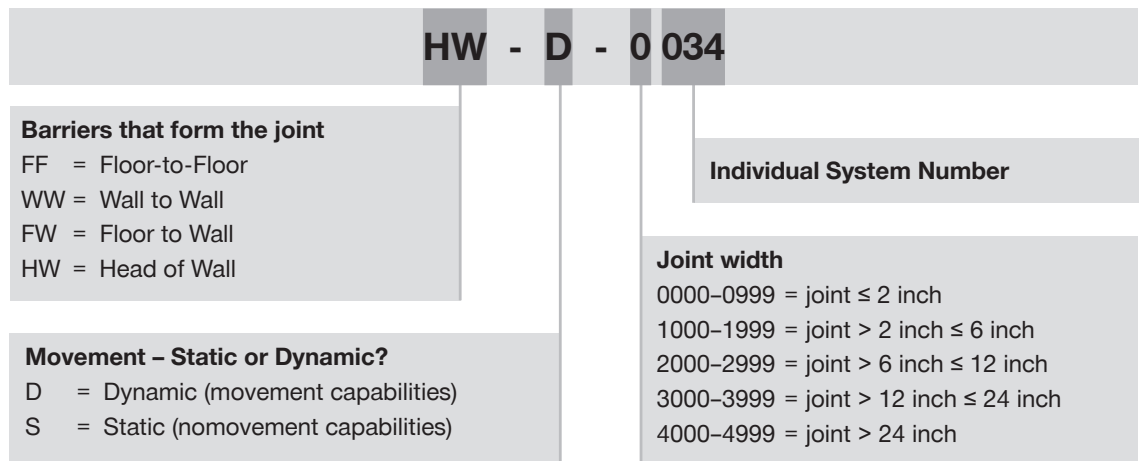

# 5. LISTED FIRESTOP SYSTEMS

A UL/CUL listed firestop system contains complete information about a tested system as per ASTM and/or Canadian standards. It shows a typical assembly of all involved components/parameters with their detailed description. It mentions overall fire rating of the testing system along with a few possible variations of different parameters, the size range of different penetrating components, plus different possible materials. It also provides a list of all applicable product ranges for the given assembly.

Fig. 5: Sample UL listing of through-penetration system

A UL system gives you information on different variations for a particular assembly/system. It is a complete document and considered credible among all the countries following UL/ASTM standards. One should first check the availability of a tested system for a particular arrangement onsite. If it is not available, only then the contractor should use the manufacturer's engineering judgment (EJ) services.

It is important to keep in mind that a manufacturer can have multiple approved systems for a specific assembly and penetrant combination, but the installation guidelines and fill materials are not interchangeable between those systems.

**Fire rating of the system as per ASTM E814**

**Min. required thickness of Floor or wall assembly**

**Max. size of all the allowed/valid penetrations along with valid material**

**Min. thickness of the sealant/firestop product to be used**

**CLASSIFIED**

Classified by Underwriters Laboratories, Inc. to UL 1479 and CANULC-S115

**System No. C-AJ-1149**

CAJ 1149

ANSI/UL1479 (ASTM E814)	CAN/ULC S115
F Rating — 2 Hr	F Rating — 2 Hr
T Rating — 0 Hr	FT Rating — 0 Hr
L Rating At Ambient — Less Than 1 CFM/sq ft	FH Rating — 2 Hr
L Rating At 400 F — 4 CFM/sq ft	FTH Rating — 0 Hr
W Rating — Class 1 (See Item 4)	L Rating At Ambient — Less Than 1 CFM/sq ft
	L Rating At 400 F — 4 CFM/sq ft

**SECTION A-A**

1. Floor or Wall Assembly — **Min 4-1/2 in. (114 mm) thick** reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m<sup>3</sup>) concrete. Wall may also be constructed of any UL Classified Concrete Blocks\*. Max diam of opening is 12 in. (305 mm). See Concrete Blocks (CAZT) category in the Fire Resistance Directory for names of manufacturers.
2. Through Penetrants — **One metallic pipe, conduit or tubing** to be installed within the firestop system. Pipe, conduit or tubing to be rigidly supported on both sides of floor or wall assembly. **The annular space shall be 0 in. (point contact)** to max 1-1/4 in. (32 mm). The following types and sizes of metallic pipes, conduits or tubing may be used:
  - A. Steel Pipe — Nom 10 in. (254 mm) diam (or smaller) Schedule 10 (or heavier) steel pipe.
  - B. Iron Pipe — Nom 10 in. (254 mm) diam (or smaller) cast or ductile iron pipe.
  - C. Conduit — Nom 4 in. (102 mm) diam (or smaller) steel electrical metallic tubing or steel conduit.
  - D. Copper Tubing — Nom 4 in. (102 mm) diam (or smaller) Type L (or heavier) copper tubing.
  - E. Copper Pipe — Nom 4 in. (102 in.) diam (or smaller) Regular (or heavier) copper pipe.
3. Packing Material — **Min 3 in. (76 mm) thickness of min 4 pcf (64 kg/m<sup>3</sup>) mineral wool batt** insulation for nom 4 in. diam (and smaller) pipes, conduits or tubings and a min 4 in. (102 mm) thickness of min 4 pcf (64 kg/m<sup>3</sup>) mineral wool batt insulation for pipe greater than nom 4 in. diam, firmly packed into opening as a permanent form. Packing material to be recessed from top surface of floor or from both surfaces of wall to accommodate the required thickness of fill material.
4. Fill, Void or Cavity Material — **Sealant — Min 1/2 in. (13 mm) thickness of fill material** applied within the annulus, flush with the top surface of floor or both surfaces of wall. At the point of contact location between pipe and concrete, a min 1/2 in. (13 mm) diam bead of fill material shall be applied at the concrete/pipe interface on the top surface of floor and on both surfaces of wall. W Rating applies only when CFS-S SIL GG, CFS-S SH-SL (floors only), CP601S, CP604 sealant or FS-ONE MAX Intumescent Sealant is used. For W Rating when FS-ONE MAX is used, packing material to be a min 4 in. (102 mm) thickness of min 4 pcf (64 kg/m<sup>3</sup>) mineral wool batt insulation.

**HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — CP601S, CP604, CFS-S SIL GG, CFS-S SIL SL (floors only), CP606 or FS-ONE Sealant or FS-ONE MAX Intumescent Sealant.**

\* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

Reproduced by HILTI, Inc. Courtesy of Underwriters Laboratories, Inc. February 20, 2015

**A valid type of components with details like annular space requirement**

**Min. required thickness and density of packing material like mineral wool**

**All Hilti products that can be used with this assembly**



## 6. ENGINEERING JUDGMENTS (EJ)

At times, a contractor may encounter a unique jobsite condition for a firestopping application which has not been tested and listed. In such cases, customized engineering judgment (EJ) firestop details are provided by the firestop manufacturer for a single application or for an entire project to account for these unique applications.

ENGINEERING JUDGMENT FIRESTOP DETAIL		THIS ENGINEERING JUDGMENT REPRESENTS A FIRESTOP SYSTEM THAT WOULD BE EXPECTED TO PASS THE STATED RATINGS IF TESTED	
Project name for which EJ is made	PROJECT :		
Customer's/company name	ISSUED TO :		
	Ratings	F-RATING = 2-HR.	
	CROSS-SECTIONAL VIEW		
	<p>1. CONCRETE FLOOR ASSEMBLY (MINIMUM 4-1/2" THICK) (2-HR. FIRE-RATING).                  2. ONE OR MORE MAXIMUM 1" NOMINAL DIAMETER STEEL CONDUIT OR STEEL EMT WITH MAXIMUM 3/4" THICK AB/PVC INSULATION.                  3. MINIMUM 4" THICKNESS MINERAL WOOL (MIN. 4 PCF DENSITY) TIGHTLY PACKED AND RECESSED TO ACCOMMODATE SEALANT.                  4. MINIMUM 1/2" DEPTH HILTI FS-ONE MAX INTUMESCENT FIRESTOP SEALANT.</p>		
Referenced tested system	<p>NOTES : 1. MAXIMUM AREA OF OPENING = 40 SQ. IN.                  2. ANNULAR SPACE = MINIMUM 1/2", MAXIMUM 12".</p>		
	Referenced Tested Systems	Project Application Details	
	(REFERENCE : ULcUL SYSTEM NO. C-AJ-8099 & C-AJ-8143)	CS0182799	
		Applicable Test Method	
		UL 1479	
	<b>HILTI</b> Hilti Firestop Systems	HILTI, Inc. Plano, Texas USA (800) 879-8000 Designed by Hilti FPE Travis Pearce	Sheet 1 of 1 Scale 3/16" = 1" Date Aug. 17, 2023 Drawing No. 602367b
	Saving Lives through Innovation and Education		Applicable test method

Fig. 6: Sample EJ provided by Hilti

Per International Firestop Counsel (IFC) guidelines, engineering judgments are firestop designs created by qualified personnel based off of third-party tested and approved systems. These designs are in accordance with the recommended IFC guidelines for evaluating firestop system engineering judgments. The International Building Code (IBC) justifies the use of engineering judgments as referenced under sections 703.2 Fire Resistance Ratings and 703.3 Alternative Methods for Determining Fire Resistance, IBC 2012. The testing and rating process ensures that each specifically designed system will maintain or exceed the hourly fire rating, as tested, for which it was approved.

Below are some of the fundamental guidelines recommended by the IFC for evaluating engineering judgments:

- Use tested systems in lieu of EJs when available
- Issued only by qualified technical personnel
- Issued for a single construction project and are not transferable to another job without review by the issuing entity
- Issued only in those locales where local code enforcement jurisdictions permit their use as suitable for meeting building code requirements
- Indicate clearly that the recommended firestop system is an Engineering Judgment and NOT a listed system
- Must identify the project name, contractor, non-standard conditions and required hourly rating
- Shows the date of issue and authorization signatures as well as the issuer's name, address and telephone number
- Must reference the number of the tested system(s) the design is based on

**A few points to remember:**

1. Qualified personnel creating it may include engineers trained for EJs by the Firestop Manufacturer.
2. As per UAE fire and life safety code, site specific EJs are issued by manufacturer along with consultant's and fire contractor's stamp. So, consultants are responsible for checking the authenticity and accuracy of an Engineering Judgement (EJ).
3. Multiple suppliers can be used for a project to minimize the need to Ejs, but material from different manufacturers cannot be used for a single system.

The project plan submittals should clearly identify which details are based on engineering judgments and these details should be provided to the field inspector.

## 6.1 UL Technical Evaluation Developer Program

In 2023, UL Solutions introduced the "Technical Evaluation Developer Program" (TEDP) which aims to improve the quality of manufacturer produced firestop Engineering Judgments, which UL has named "Technical Evaluations". Firestop manufacturers who have qualified for the TEDP have demonstrated their expertise in developing reliable technical evaluations through 1) completion of competency examinations by their technical personnel, 2) completion of audit reviews by UL staff, and 3) certification testing of randomly selected EJs developed by the manufacturer.

This UL program seeks to reduce the number of low-quality EJs in the market and increase the testing and certification efforts within the fire protection industry. Code enforcement officials and construction professionals can feel confident that a firestop manufacturer who has qualified for the program will provide EJ solutions that meet the specified life safety requirements of the project.

## 7. INSPECTION PROCESS

The performance of any passive fire protection system to impede the spread of smoke and fire is directly proportional to the quality of the installation. Firestop inspections provide quality control and quality assurance that the firestop systems installed on a project meet the required fire resistance requirements defined by the building code and local jurisdiction.

The International Building Code (Section 1705, 2018) requires inspection of firestopping systems for high-rise buildings, Risk Category III, and Risk Category IV projects. Inspection of these projects are to be performed by a third-party special inspector who is specifically licensed to perform these inspections. The third-party inspectors must follow ASTM E2174 “Standard Practice for On-Site Inspection of Penetration Firestops” and ASTM E2393 “Standard Practice for On-Site Inspection of Fire-Resistant Joint Systems and Perimeter Fire Barriers”. These ASTM standards provide guidelines for conducting visual inspection and destructive testing of firestop installations.

For projects outside of the special inspection requirements, general inspection of passive fire protection systems is still imperative to ensure life safety of the building and its occupants. Since it is not feasible to inspect every firestop penetration or the entire length of a fire-resistive joint, the referenced ASTM standards for on-site inspection can provide general guidelines for the percentage of work to inspect.

The firestop inspection process typically begins by obtaining the approved firestop system documentation. During the construction phase, the Contractor should maintain documentation of all the listed firestop systems and engineering judgments that were utilized on the project. These firestop system details should serve as a blueprint for the firestop installer to properly select and install the appropriate firestopping materials. These documents will also serve as a blueprint for inspectors when verifying the proper installation of the firestopping materials.

Some of the recommended guidelines and best practices for performing a quality on-site inspection of firestopping installations include:

- Coordinate/schedule the on-site inspection during the installation phase and again at a final walk-through.
- Contractor should not conceal any firestop systems until after the work has been inspected and approved.
- Review the construction documents to identify the location of the fire rated wall/floor assemblies within the building.
- Obtain a copy of the approved firestop system submittal package for the project.
- Compare the installed firestop system with the corresponding firestop detail within the approved submittal package.
- Observe empty containers, boxes, or other packaging to identify the specific firestopping products installed are as specified in the submittal package.

The following sections of this guidebook provide more detailed guidelines for inspecting specific types of firestop systems on a project.



Fig. 7: Sealant thickness measurement when wet



## 8. INSPECTION GUIDELINES FOR THROUGH PENETRATIONS FIRESTOP SYSTEMS

When a building system component, such as plumbing piping, electrical conduit, cabling, etc, penetrates through a fire rated floor or wall assembly, the fire resistance integrity of that assembly is breached. An appropriate firestopping material must be installed per a tested firestop system that matches the specific penetration application in order to restore the integrity of the fire rated assembly.

For firestopping of through penetrations, some of the commonly used firestopping materials include:

- Preformed firestop products such as firestop plugs (Hilti CFS-PL), firestop collars (Hilti CP643/644) or wrap strips (Hilti CP648) for single pipe penetrations.
- Firestop blocks (Hilti CFS-BL) for multiple pipe penetrations in large openings.
- Firestop devices such as a firestop modular sleeve (Hilti CFS-MSL) or speed sleeve (Hilti CP653) for cable bundles.
- Cast-in-place firestop floor devices (Hilti CP680, Hilti CFS-CID U, Hilti CFS-CID MD).
- Acrylic based firestop sealants (Hilti CP606)
- Silicone based firestop sealants (Hilti CFS-S SIL)
- Intumescent firestop sealants (Hilti FS-ONE MAX).

### 8.1 Steps for inspection

CHECK POINTS FOR THROUGH PENETRATIONS	OBSERVATION	COMMENTS
1) Is the hourly fire rating of the referenced firestop system or EJ greater than or equal to the fire rating of the floor/wall assembly being penetrated?	Yes No N/A	
2) Does the floor or wall construction match the floor/wall assembly listed in the firestop system or EJ?	Yes No N/A	
3) Does the penetrating Item(s) match the acceptable list of penetrants (material, size, diameter, insulation type and thickness, etc.) shown in the firestop system or EJ?	Yes No N/A	
4) Does the field installation comply with the following requirements of the referenced firestop system or EJ?	Yes No N/A	
a) Size of opening	Yes No N/A	
b) Minimum and maximum annular space requirements	Yes No N/A	
c) Proper backing material (when required)	Yes No N/A	
d) Proper firestopping product, including type, amount, thickness, orientation, etc.	Yes No N/A	
e) Proper accessories installed, including anchor/fasteners, mounting or cover plates, frames, etc.	Yes No N/A	
f) For multiple penetrants: proper distance between penetrating items	Yes No N/A	
g) For cables: allowable cable size, spacing, bundle size, and percent fill of opening	Yes No N/A	
5) For wall assemblies, verify that the field installation was installed properly on both sides of the wall	Yes No N/A	

## 8.2 Example comparison

### 8.2.1 Correct installation

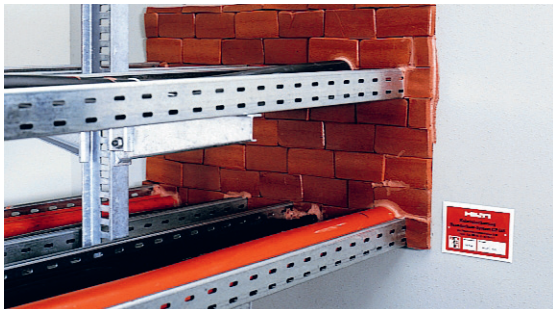


Fig. 8: Preformed firestop block, Hilti CFS-BL Firestop Block used for sealing large openings with multiple through penetrations. The firestop block should be stacked with staggered seams within the opening



Fig. 9: Firestop collar, Hilti CP-643 N, used for sealing large metallic pipes



Fig. 10: Speed sleeve with gang plate, Hilti CFS-SL GA used for small cable bundles



Fig. 11: Group of modular sleeves with gang plate for sealing multiple cable bundles of different sizes Hilti CFS-MSL GPA. [Watch the video](#)



Fig. 12: Firestop cable disc, Hilti CFS-D used for sealing a cable bundle of size < 1 in. [Watch the video](#)



Fig. 13: Device flange should be secured to the top surface as per listed system Hilti CFS-DID

## 8.2.2 Incorrect installation



Fig. 14: Sealant not properly tooled leaving gaps in the installation



Fig. 15: Multiple cable collars Hilti CP-643 N used for sealing a large opening, leaving gaps in the installation

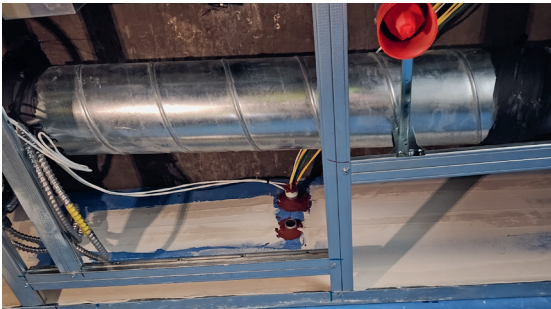


Fig. 16: Blank opening (bottom one out of two sealed small openings)



Fig. 17: Hilti CP 680 sleeve not cast into concrete



Fig. 18: Gaps in opening exist



Fig. 19: Incorrect installation of collar installed on top side of floor

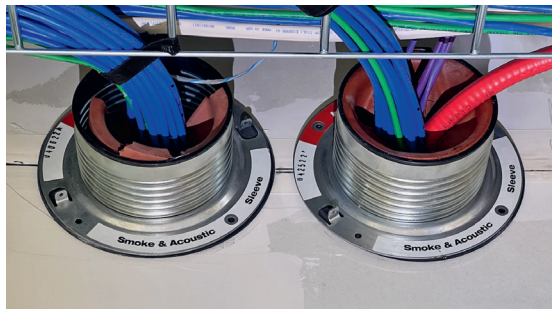


Fig. 20: Incorrect on the left as the red intumescent strip is not evenly distributed, leaving gaps. Correct on the right

## 9. INSPECTION GUIDELINES FOR MEMBRANE PENETRATIONS FIRESTOP SYSTEMS

A membrane penetration occurs when a building system component penetrates only one side of a fire rated floor/wall assembly. Examples of membrane penetrations include electrical outlet boxes, junction boxes, and piping/conduit penetrating only one side of the floor/wall assembly.

For cases where a penetrating items, such as a plumbing pipe, electrical conduit, cables, etc., only penetrates one side of a fire rated floor/wall assembly, this membrane penetration can be properly addressed by following the requirements of a through penetration firestop system that matches the application.

For the firestopping of membrane penetrations, some of the most commonly used firestopping materials include:

- Preformed firestop products such as firestop plugs (Hilti CFS-PL), firestop collars (Hilti CFS CC) or wrap strips (Hilti CFS-WS) for single pipe penetrations. Firestop putty discs (Hilti CFS-D) for cable penetrations.
- Firestop putty pads (Hilti CP 617) for protecting outlet boxes and junction boxes.
- Flexible, silicone based firestop sealants (Hilti CP606)
- Elastomeric firestop sealants (Hilti CP601S)
- Intumescent firestop sealants (Hilti FS-ONE MAX)

### 9.1 Steps for inspection

CHECK POINTS FOR MEMBRANE PENETRATIONS	OBSERVATION	COMMENTS
1) Is the hourly fire rating of the referenced firestop system or EJ greater than or equal to the fire rating of the wall assembly being penetrated?	Yes No N/A	
2) Does the wall construction match the wall assembly listed in the firestop system or EJ?	Yes No N/A	
3) Does the penetrating Item(s) match the acceptable list of penetrants (material, size, diameter, insulation type and thickness, etc.) shown in the firestop system or EJ?	Yes No N/A	
4) Does the field installation comply with the following requirements of the referenced firestop system or EJ?	Yes No N/A	
a) Size of opening	Yes No N/A	
b) Minimum and maximum annular space requirements	Yes No N/A	
c) Proper backing material (when required)	Yes No N/A	
d) Proper firestopping product, including type, amount, thickness, orientation, etc.	Yes No N/A	
e) Proper accessories installed, including anchor/fasteners, mounting or cover plates, frames, etc.	Yes No N/A	
f) For multiple penetrants: proper distance between penetrating items	Yes No N/A	
g) For putty pads: is it installed on all proper sides of the outlet box	Yes No N/A	

## 9.2 Correct examples

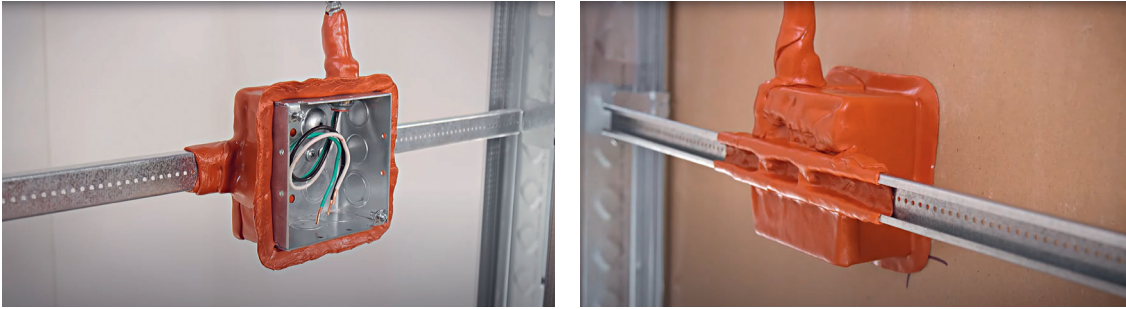


Fig. 21: Putty pad, Hilti CP 617, for sealing electrical box inside walls.

[Watch the video](#)

## 10. INSPECTION GUIDELINES FOR FIRE RESISTIVE JOINTS

When a fire rated wall/floor assembly intersects another wall/floor assembly an opening or joint exists that needs to be properly sealed in accordance with a fire resistive joint system. The fire resistive joints occur at the top-of-wall (head-of-wall), bottom-of-wall, floor-to-wall, wall-to-wall, and floor-to-floor conditions.

Fire resistive joint systems are design to prevent the spread of fire through a linear opening between the two fire rated wall/floor assemblies. In addition, most joint systems also accommodate movement, compression and/or extension, of the joint.

For fire resistive joint systems, some of the commonly used firestopping materials include:

- Preformed firestop products such as a firestop top track seal (Hilti CFS-TTS), firestop bottom track seal (Hilti CFS-BTS).
- Flexible, silicone based firestop sealants (Hilti CP606)
- Elastomeric firestop sealants (Hilti CP601S)
- Water-based firestop sprays (Hilti CFS-SP WB)

### 10.1 Steps for inspection

CHECK POINTS FOR JOINTS	OBSERVATION	COMMENTS
1) Is the hourly fire rating of the referenced fire resistive joint system or EJ greater than or equal to the fire rating of the floor/wall assembly?	Yes No N/A	
2) Does the floor and/or wall construction match the floor/wall assembly listed in the firestop system or EJ?	Yes No N/A	
3) Is the fire resistive joint system tested for the amount of movement required for the assembly? Does it match the required class and type of movement?	Yes No N/A	
4) Does the field installation comply with the following requirements of the referenced fire resistive joint system or EJ?	Yes No N/A	
a) Minimum and/or maximum width of the joint	Yes No N/A	
b) Proper backing material (when required), including proper orientation and compression of backing material	Yes No N/A	
c) Proper firestopping product, including type, amount, thickness, orientation, etc.	Yes No N/A	
d) Proper accessories installed, including anchor/fasteners, mounting or cover plates, frames, etc.	Yes No N/A	
e) For firestop spray products: does the applied firestop spray overlap the adjacent surfaces properly?	Yes No N/A	

### 10.2 Example comparison

#### 10.2.1 Correct installation



Fig. 22: Flexible firestop sealant (Hilti CP606 - white) applied to both sides of the wall with mineral wool backing material



Fig. 23: Firestop sealant applied to the top-of-wall joint



Fig. 24: Hilti CFS-TTS used on top of wall joint

[Watch the video](#)

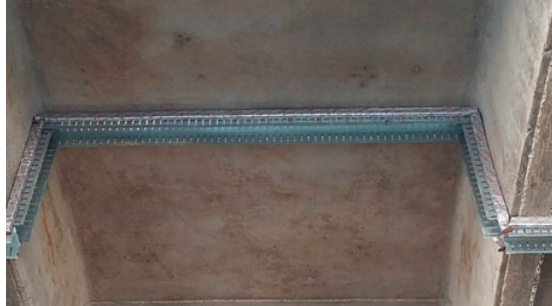


Fig. 25: Hilti CFS-TTS used on top of wall joint

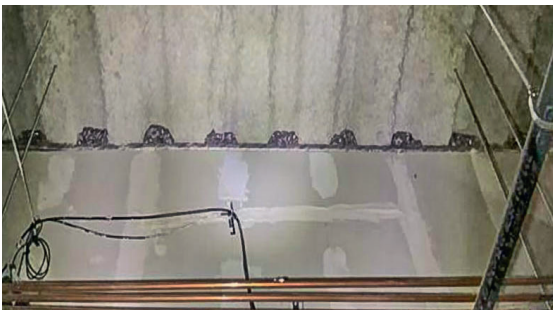


Fig. 26: Hilti CFS-TTS MD installed correctly per EJ



Fig. 27: Bottom track seal installed on floor runner



Fig. 28: Hilti CFS-TTS MD installed correctly per EJ

10.2.2 Incorrect installation



Fig. 29: Gap in application



Fig. 30: Inadequate width of the sealant/gap



Fig. 31: Head of wall joint – width exceeded listed system



# 11. INSPECTION GUIDELINES FOR PERIMETER FIRE BARRIER SYSTEMS

A perimeter fire barrier system is designed to prevent the spread of fire through a linear opening between a fire rated floor assembly and a non-fire rated exterior wall assembly. The continuity requirements of the building codes state that the rating of a floor assembly must extend to and be tight against the exterior wall assembly.

For a perimeter fire barrier system, some of the common firestopping materials used include:

- Preformed firestop products (Hilti CFS EOS Quick Seal)
- Water based firestop spray (Hilti CFS SP WB)
- Silicone based firestop spray (Hilti CFS SP SIL)

## 11.1 Steps for inspection

CHECK POINTS FOR PERIMETER FIRE BARRIER SYSTEMS	OBSERVATION	COMMENTS
1) Is the hourly fire rating of the referenced perimeter fire barrier system or EJ greater than or equal to the fire rating of the floor assembly?	Yes No N/A	
2) Does the floor construction and the exterior wall construction match the floor/wall construction listed in the perimeter fire barrier system or EJ?	Yes No N/A	
3) Does the curtain wall construction comply with the following requirements of the referenced perimeter fire barrier system or EJ?	Yes No N/A	
a) Does the system include vision glass (if applicable)?	Yes No N/A	
b) Proper spacing of mullions and transoms?	Yes No N/A	
c) Proper mullion coverings (type, thickness, density, etc.)	Yes No N/A	
d) Proper curtain wall spandrel insulation (type, thickness, density, etc.)	Yes No N/A	
e) Proper spandrel panel perimeter angles or stiffeners (dimensions, gauge, fastener spacing, etc.)	Yes No N/A	
4) Does the field installation of the firestopping materials comply with the following requirements of the referenced fire resistive joint system or EJ?	Yes No N/A	
a) Minimum and/or maximum width of the joint	Yes No N/A	
b) Proper backing material installed including proper orientation, depth and compression of backing material	Yes No N/A	
c) Proper firestopping product, including type, amount, thickness, orientation, etc.	Yes No N/A	
d) Proper accessories installed, including support clips for backing material.	Yes No N/A	
e) For firestop spray products: does the applied firestop spray overlap the adjacent surfaces properly?	Yes No N/A	

# 11.2 Example comparison

## 11.2.1 Correct installation



Fig. 32: Sealant Hilti CP-672, application in edge of slab assembly



Fig. 33: Correct depth of sealant, Hilti CFS-SP SIL

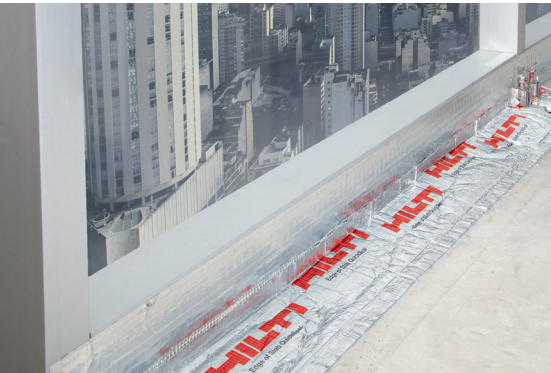


Fig. 34: Comparison between [CFS-EOS QuickSeal](#) vs traditional method

## 11.2.2 Incorrect installation




Fig. 35: Cracked sealant coating

## 12. HIGHLY RECOMMENDED GLOBAL BEST PRACTICES

Prior to selection of firestopping material, contractors should prepare a real site Bill of Quantity (BOQ) for all project's applications (Construction joints / Through penetrations) to include all necessary information on penetrants (size, material, and service type) and openings size along with corresponding tested systems / EJs. This shall be submitted to the consultant for verification and approval.

Contractors should provide an undertaking letter to the consultants as part of firestopping BOQ submittal, stating that the BOQ is project specific. Consultants should approve firestopping supplier based on real site BOQ with approved listed systems.

In absence of a tested system contractors should ensure that multiple suppliers are checked for a tested system before asking for an EJ from a manufacturer. To prevent EJs, adhere to the process outlined below:

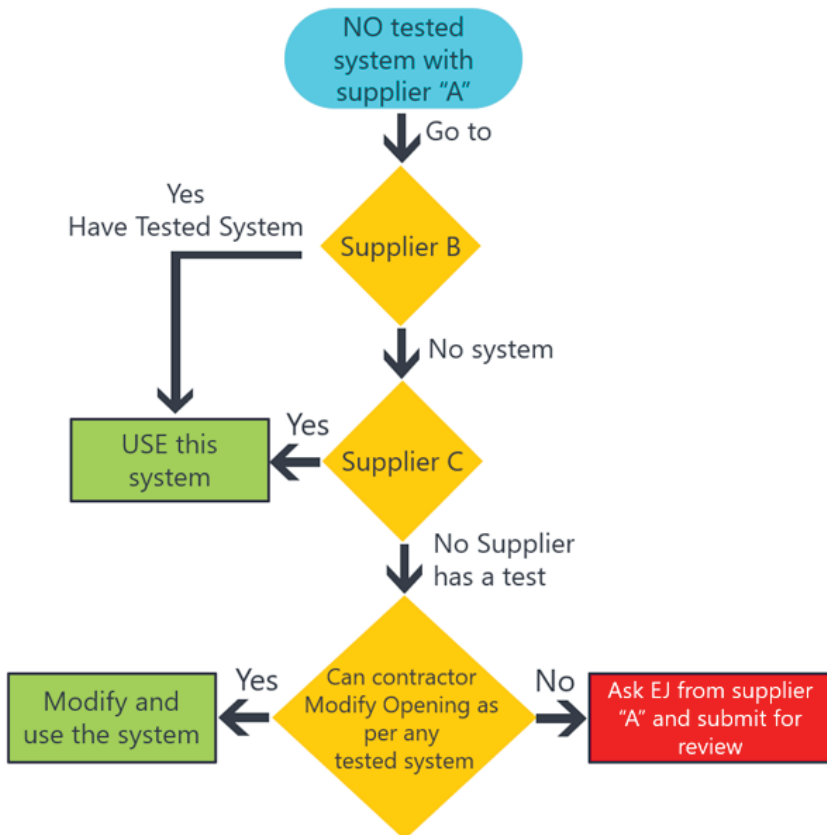

The EJ provided from manufacturer should be combined with a justification letter explaining the logic and references behind creation of proposed EJ. Consultant or House of Expertise should approve/reject EJs. Consultants or House of Expertise may reject EJs without proper justification.

Below should be included in final handover report:

- Percentage / quantification of tested systems Vs Ejs used in full project.
- Firestopping material comparison between "initial estimated real-site BOQ quantities" Vs ,final supply certificate of procured quantities"
- A Progress inspection should be conducted by qualified firestop inspectors from the consultant / HOE and to be recorded, documented, and carried in accordance with firestopping installation progress percentage at 20%, 40%, 60%,80% and 100%. All inspection reports should be included and submitted along with the final Handover submission.

## 13. PERFORMANCE OF CONSTRUCTION MATERIALS UNDER FIRE

### 13.1 Mineral wool vs. insulation

Mineral wool is a key component used in many firestop systems as a backing material for the firestop sealant to be installed against when you have larger annular space.

The reason for its popularity as an ideal firestop backing material is that it does not conduct heat and can resist temperatures over 1,000 °C. Since its density is over three times more than fiberglass insulation, mineral wool also offers better acoustic insulation properties. Other materials used on site for insulation purposes like foam, fiberglass insulation, backer rods, etc., usually burn easily and quickly in the event of a fire, thus are not suitable alternatives to mineral wool. When inspecting firestopping applications, it is imperative that the proper backing material is installed, including the proper orientation and compression, per the listed firestop system.

For the correct installation of Mineral Wool (MW), it needs to be cut perpendicular to the fibers and to be assembled along the fibers to allow for the required compression.

### 13.2 Combustible and non-combustible pipes

Combustible and non-combustible pipes act in different ways in case of a fire due to the difference in their flammable properties.

Combustible pipes like plastic pipes (PVC) burn away creating a hole/opening in place of the pipe. Combustible pipe penetrations generally require intumescent materials to properly firestop around the penetration. These could be an intumescent sealant or intumescent device such as a firestop collar or firestop cast-in device. Intumescent products consist of materials which rapidly expand when exposed to fire and seal or close the annular space around the combustible pipe as it burns away.

Non-combustible pipes like metallic pipes do not burn. They melt leaving a char or residue behind. For non-combustible pipes, non-intumescent products such as flexible or elastomeric firestop sealants are generally sufficient to properly firestop a non-combustible pipe penetration. Always refer to a tested UL firestop system or engineering judgment which will identify the appropriate firestopping products to be installed for the specific application.

Different plastic pipes like PP, PPR have different composition, pipe thickness/schedule (SDR) and will act differently in case of fire.

### 13.3 Dependency on tested system

- The performance of various materials is heavily dependent on sealing of the site system according to the tested one.
- It is important to check the annular gap between penetrants in case of multiple penetration. The gaps should be according to the tested system, otherwise it could result in deviation from the required fire rating
- System tested for closed pipe cannot be used to create EJs for open pipe and vice-versa. For closed systems, the unexposed side (non-fireside) of the through penetrating item is capped or sealed during the test. The exposed side is always capped or connected whereas open pipe is not pressurized and is not connected to anything or open to atmosphere at at least one end.

- Application of firestopping material on dampers should be avoided as it can hamper the proper functioning of dampers. If it is not avoidable, approval from damper manufacturer should be attained beforehand.
- Similarly, tested system should indicate the requirement of firestopping material on retaining angles. (Retaining angles are used to stiffen large ducts preventing it from bending in case of fire).



Hilti Corporation  
9494 Schaan, Liechtenstein  
P +423-234 2965

[www.facebook.com/hiltigroup](https://www.facebook.com/hiltigroup)  
[www.hilti.group](https://www.hilti.group)